

THE WORLD TRADE CENTER  
OF NY & NJ



ORIGINAL SIGNED & SEALED BY  
N.Y. P.E. (OR R.A.)

**Joseph R. Loring & Associates, Inc.**  
consulting engineers  
One Pennsylvania Plaza  
New York, New York 10008-0045  
Tel: (212) 512-7400, Fax: (212) 512-7342

THE OFFICE OF  
**DAVID ELLIOT LEBOWITZ**  
P.C.  
ARCHITECTS & PLANNERS  
10 WEST STREET NEW YORK, NY 10006  
TEL: (212) 512-7400 FAX: (212) 512-7342

**LESLIE E. ROBERTSON**  
ASSOCIATES, P.L.L.C.  
CONSULTING ELECTRICAL ENGINEERS  
25 EAST 40TH STREET  
NEW YORK, NY 10018-3608  
TEL: (212) 512-7400 FAX: (212) 512-7342

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-945-071 IN THE FORM IN WHICH SAID DRAWINGS EXIST AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.  
DATE: 11/6/98 *Sullivan A. McKim* SPEC. WRITER  
DATE: 4/10/97 *P.K. Manning* ENGINEER OF DESIGN

No.	Date	Revision	Approved
1	11/17/97	ISSUED FOR BD	
Engineering Department			
Design Divisions			
The World Trade Center			



Title: **STANDBY POWER  
5 WORLD TRADE CENTER**

**ELECTRICAL**


**5 WTC PART PLANS  
CONDUIT RISER SHAFTS  
& DETAILS SHEET 1**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.


F.P.P.	M.A.R.	
Designed by	Drawn by	Check by
Date: 11/17/97	Scale: AS NOTED	
Contract Number: WTC-945-071	Drawing Number: E4-02	

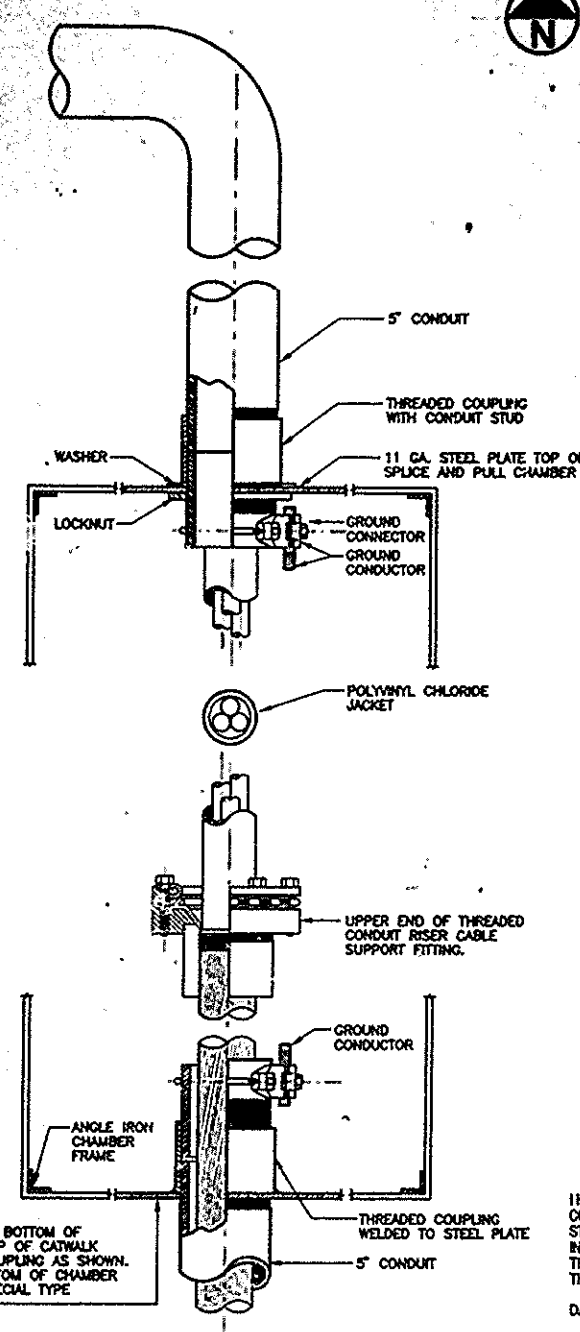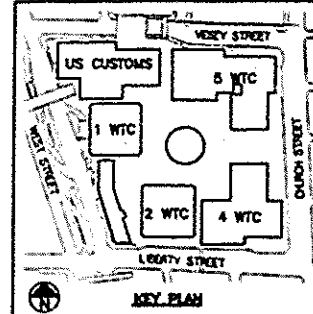


TYPICAL INSTALLATION DETAIL OF  
15 KV ARMORED CABLE SUPPORTS  
IN SPLICE AND PULL CABINET  
NOT TO SCALE

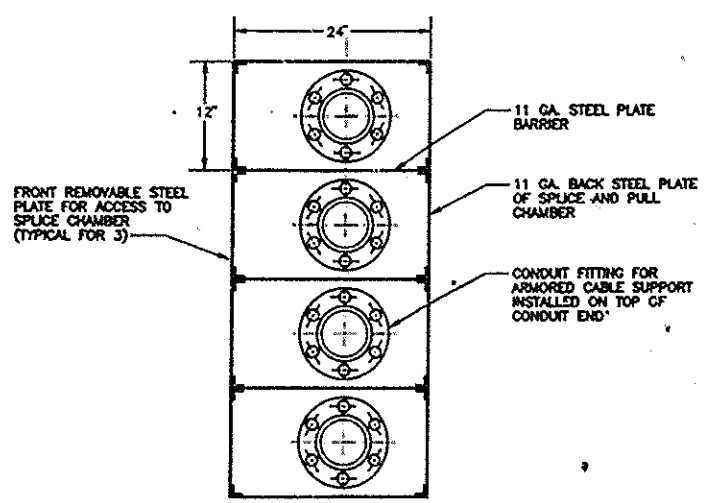


DETAIL "A"  
HORIZONTAL SECTION THRU  
CABLE PULL & SPLICE CABINET  
AT CABLE SUPPORT FITTINGS  
NOT TO SCALE

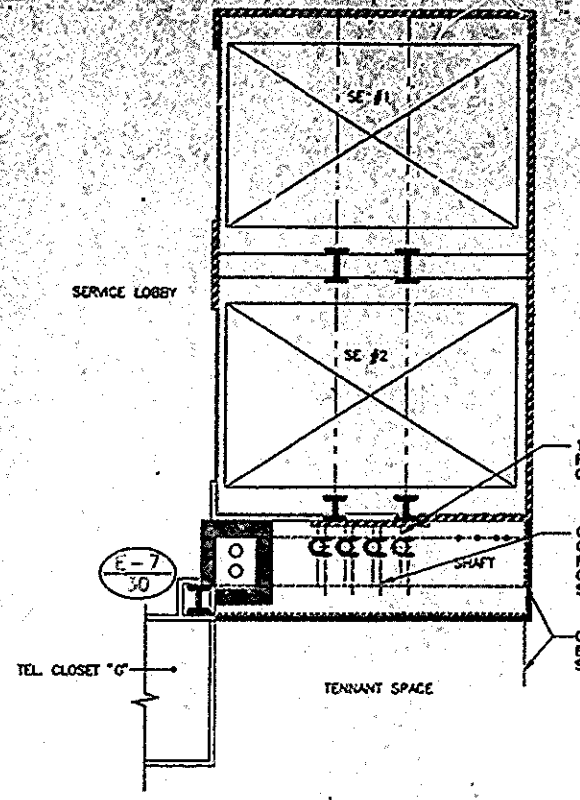


2ND FLOOR PART PLAN

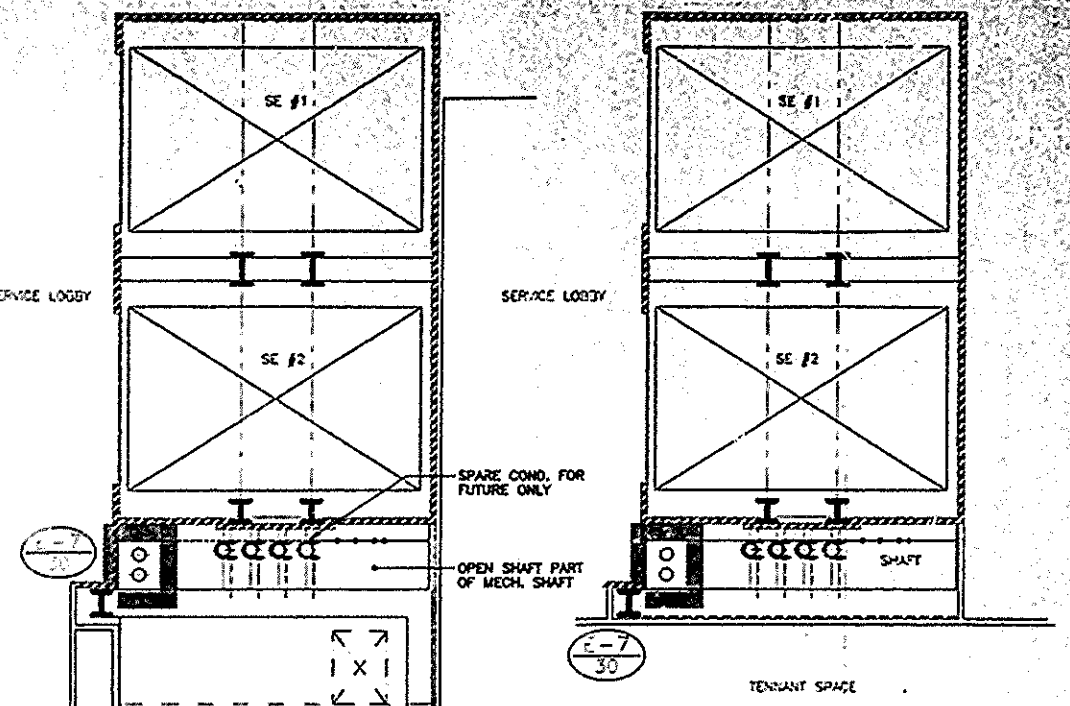

3RD FLOOR PART PLAN

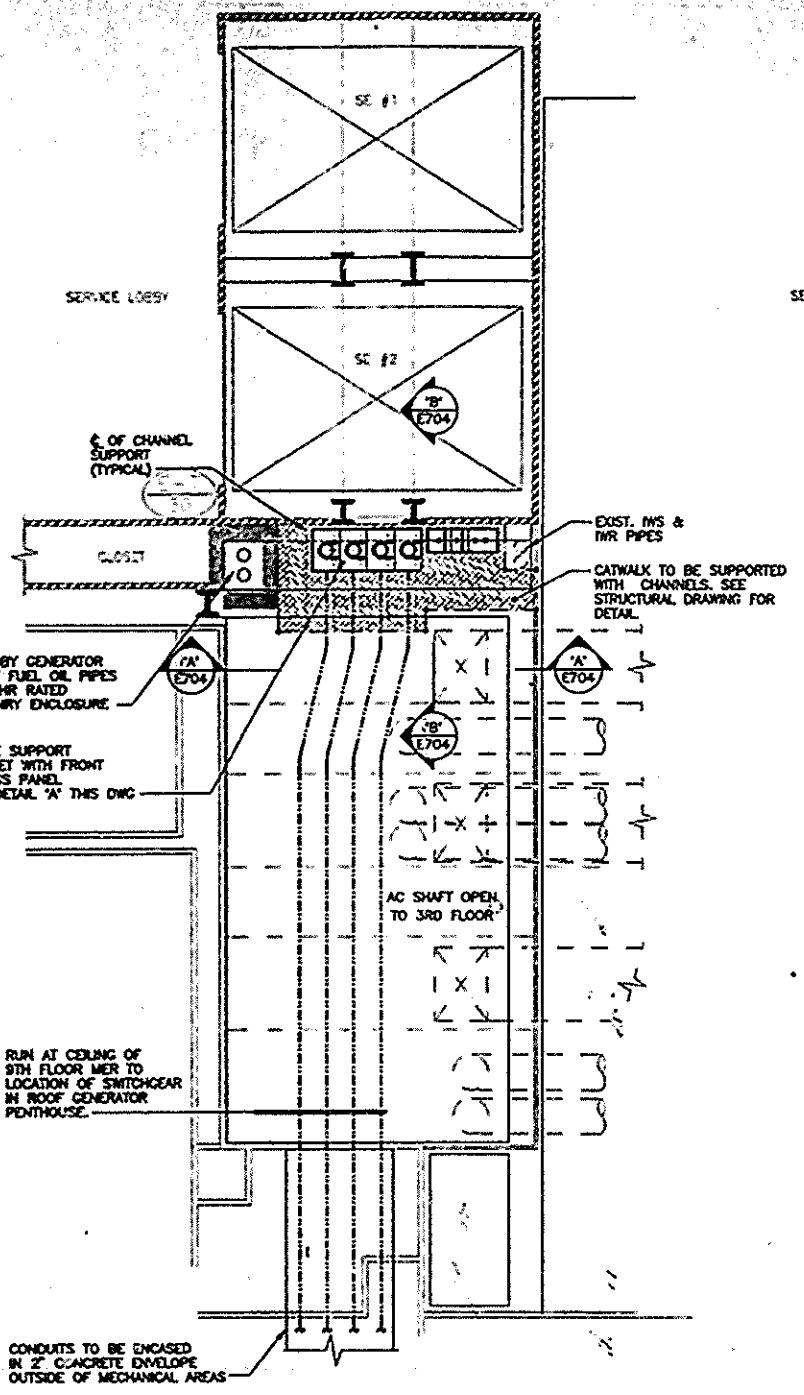

PART PLAN  
TYPICAL FOR 4TH THRU 8TH FLOOR

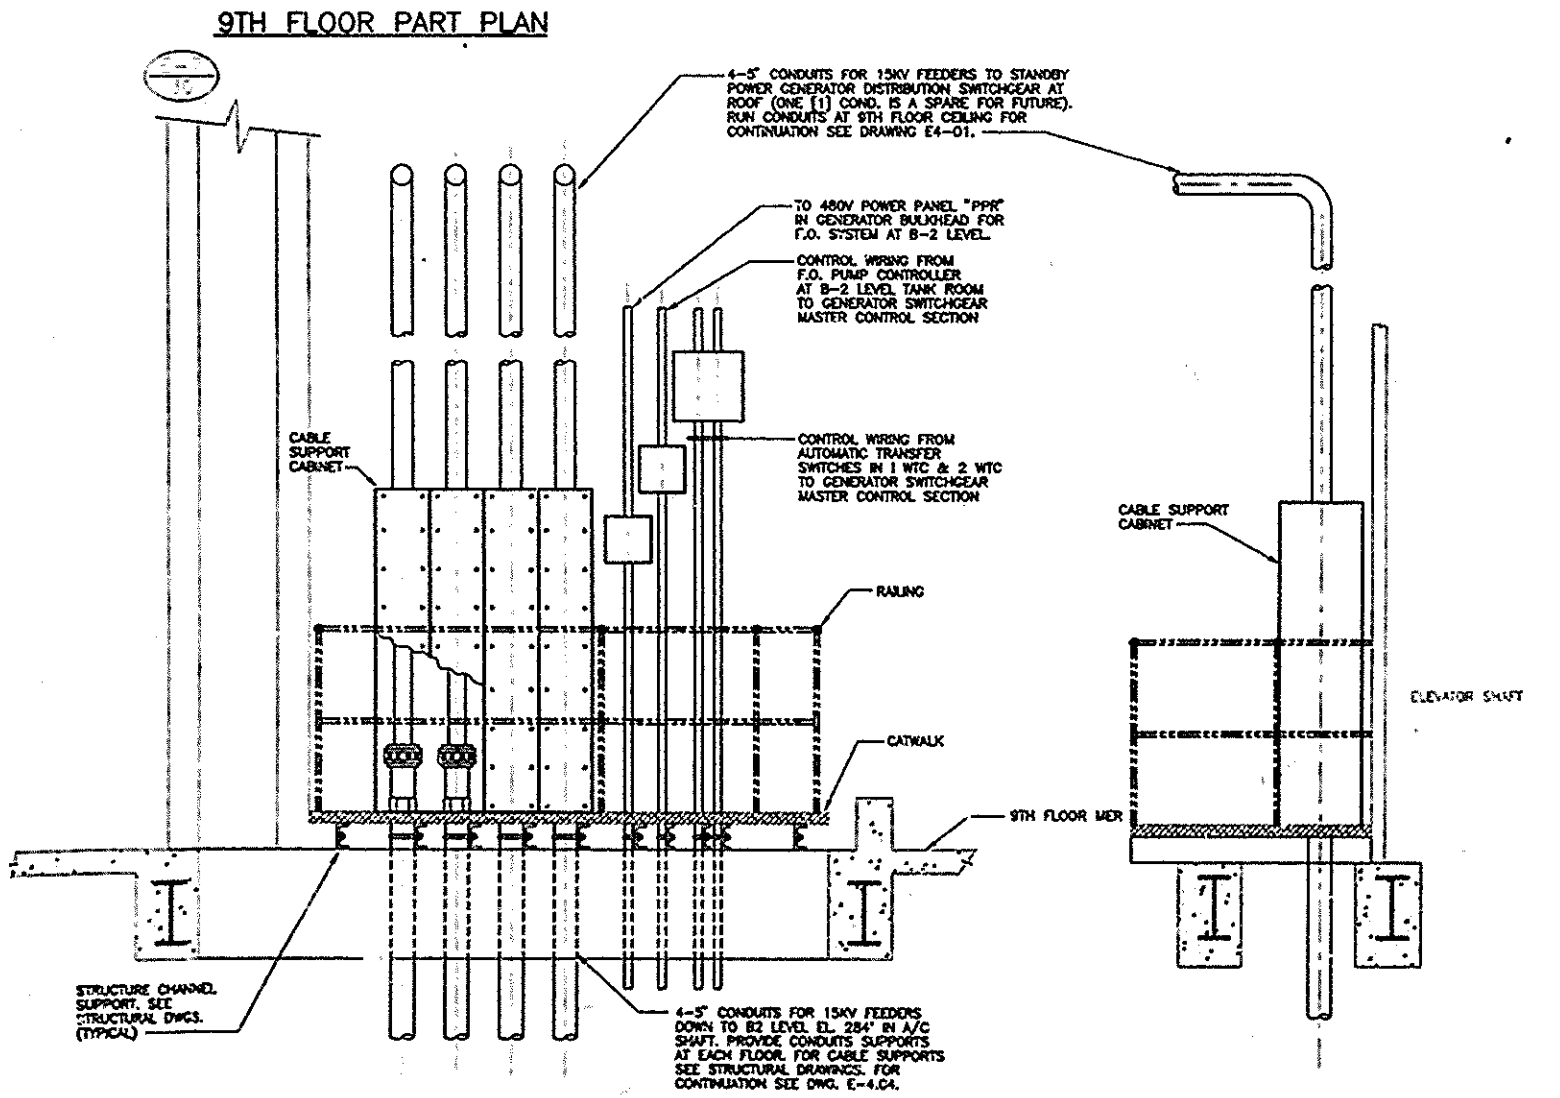

SECTION 'A-A'

SECTION 'B-B'